




Flexible Connector

Type FF/LD & FF/LD/HP

Larger Diameters & Higher Working Pressures

SUBMITTAL

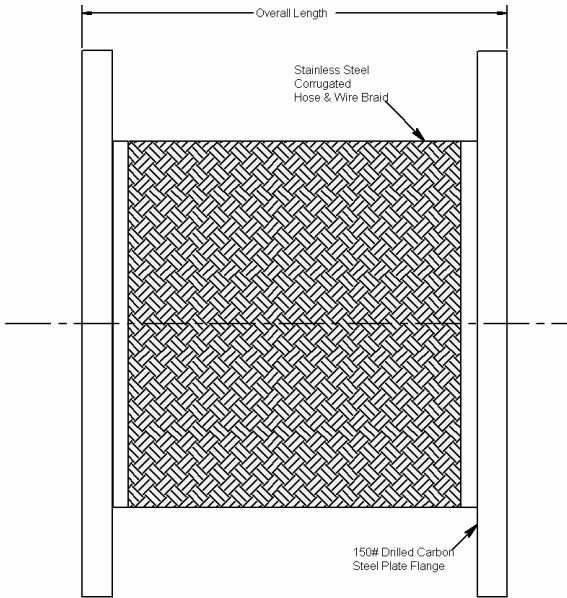

Job _____
Contractor _____
Engineer _____
Representative _____
Order No. _____ Date _____
Submitted by _____
Approved by _____ Date _____
Tag _____

Typical Specification:

Provide, where indicated, a flexible connector consisting of 300 series stainless steel corrugated hose surrounded and supported by 300 series stainless steel braid. End fittings are to be carbon steel 150# drilled plate flanges. Connector to be ____ inches pipe size by ____ length; Thermo Tech model FF/LD, FF/LD/HP or equal.

Nominal Size Inches	Overall Length Inches	FF/LD Hose & Braid W/P PSIG	FF/LD/HP Hose & Braid W/P PSIG	Plate Flange W/P PSIG	FF/LD/HP-ANSI Hose & Braid W/P PSIG	ANSI-150 Forged Flange W/P PSIG
12	14	165	255	175	255	285
14	14	150	190	150	190	285
16	14	110	170	150	170	285
18	14	85	150	150	NA	NA



287 South Sante Fe Drive
 Denver, Colorado 80223
 Phone (303) 698-9988
 www.thermotechdenver.com